


3/4" x 5/8" AND 1" WATER METER

ELEVATION

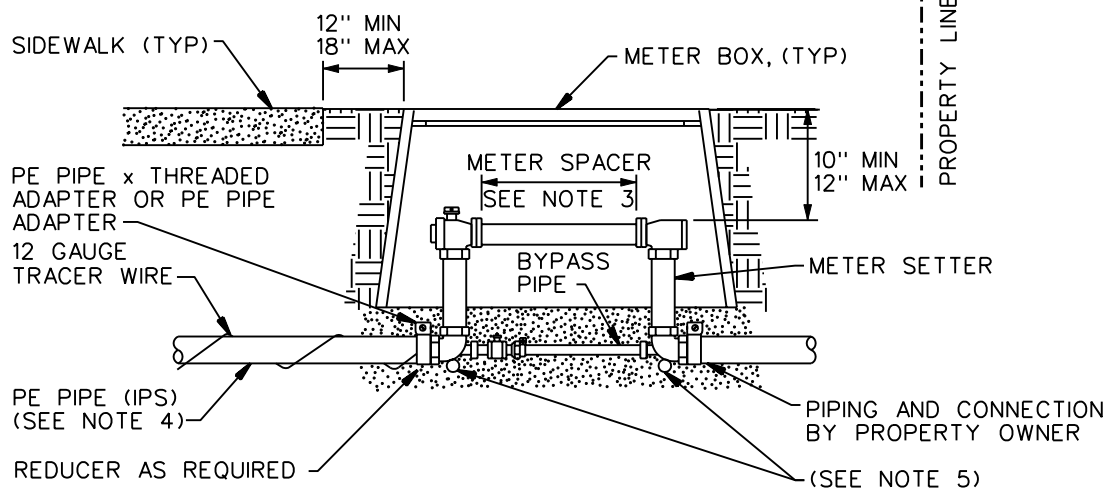

1-1/2" AND 2" WATER METER

ELEVATION
NOT TO SCALE

NOTES:

1. SEE STD. DETAIL 701A, 701B, 703, AND 716 FOR ADDITIONAL DETAILS.
2. SET METER BOX FLUSH WITH SIDEWALK OR CURB ELEVATION IF LOCATED IN LAWN AREA. SET METER BOX APPROX. 2" ABOVE FINISHED GRADE IF LOCATED IN LANDSCAPING AREA.
3. SPACER FOR A 1-1/2 INCH METER IS 13-1/4 INCHES IN LENGTH. SPACER FOR A 2-INCH METER IS 17-1/4 INCHES IN LENGTH. SPACER PROVIDED BY CONTRACTOR.
4. SEE CONSTRUCTION DRAWINGS FOR SERVICE CONNECTION PIPE SIZE.
5. METER SETTER MAY BE HORIZONTAL OR VERTICAL INLET AND OUTLET.
6. ALL FITTINGS SHALL BE BRASS.
7. TOUCHREAD PAD HOLE TO BE DRILLED BY CITY.

APPROVED: LYNN ARAKAKI

REV. DATE: NOV. 01, 2005

WATER/WASTEWATER DIVISION



STANDARD DETAILS

METER SETTER DETAILS

FILE SD702.DGN DRAWING NO. 702